


Example of useful AHU BACnet

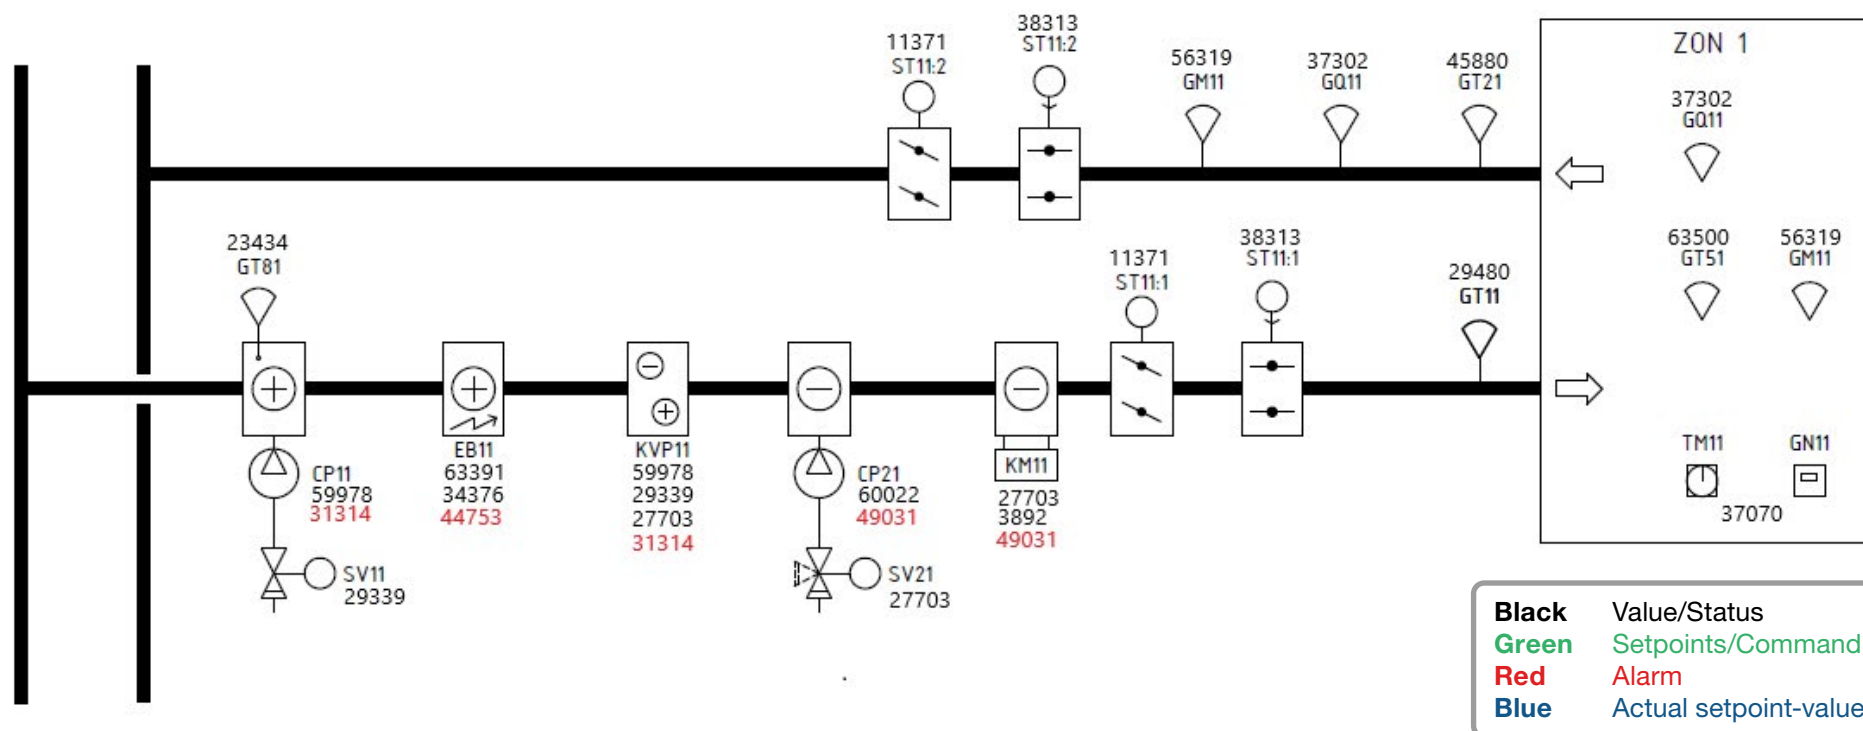

ZON 1		Z1		GT51		Z1		Room temp		EB11		Z1		EI heating alarm	
	44260	Z1	Temp setpoint		GQ11	37302	Z1	Air quality		SV21	27703	Z1	Cooling output signal		
	59929	Z1	Temp deadzone		GQ11	8407	Z1	Air quality setpoint		CP21	60022	Z1	Cooling pump command		
Only when cascade	61798	Z1	Temp current supply setpoint heating		GM11	56319	Z1	Humidity		CP21	49031	Z1	Cooling pump alarm		
	35661	Z1	Temp current supply setpoint cooling		GM11	100889	Z1	Humidity setpoint		KM11	3892	Z1	DX cooling command		
	36432	Z1	Temp current setpoint heating		SV11	29339	Z1	Heating output signal		KM11	49031	Z1	DX cooling alarm		
	62587	Z1	Temp current setpoint cooling		CP11	59978	Z1	Heating pump command		ST11:X	11371	Z1	Damper output signal		
GT11	29480	Z1	Supply temp		CP11	31314	Z1	Heating pump alarm		ST11:X	38313	Z1	Damper command		
GT21	45880	Z1	Extract temp		EB11	63391	Z1	EI heating output signal		TM1/GN11	37070	Z1	External control input		
GT81	23434	Z1	Frost temp		EB11	34376	Z1	EI heating command							